




WIREFRASS

ELECTRIC COOPERATIVE

A PowerSouth Energy Cooperative

www.wiregrass.coop

Service Equipped for Temporary Service

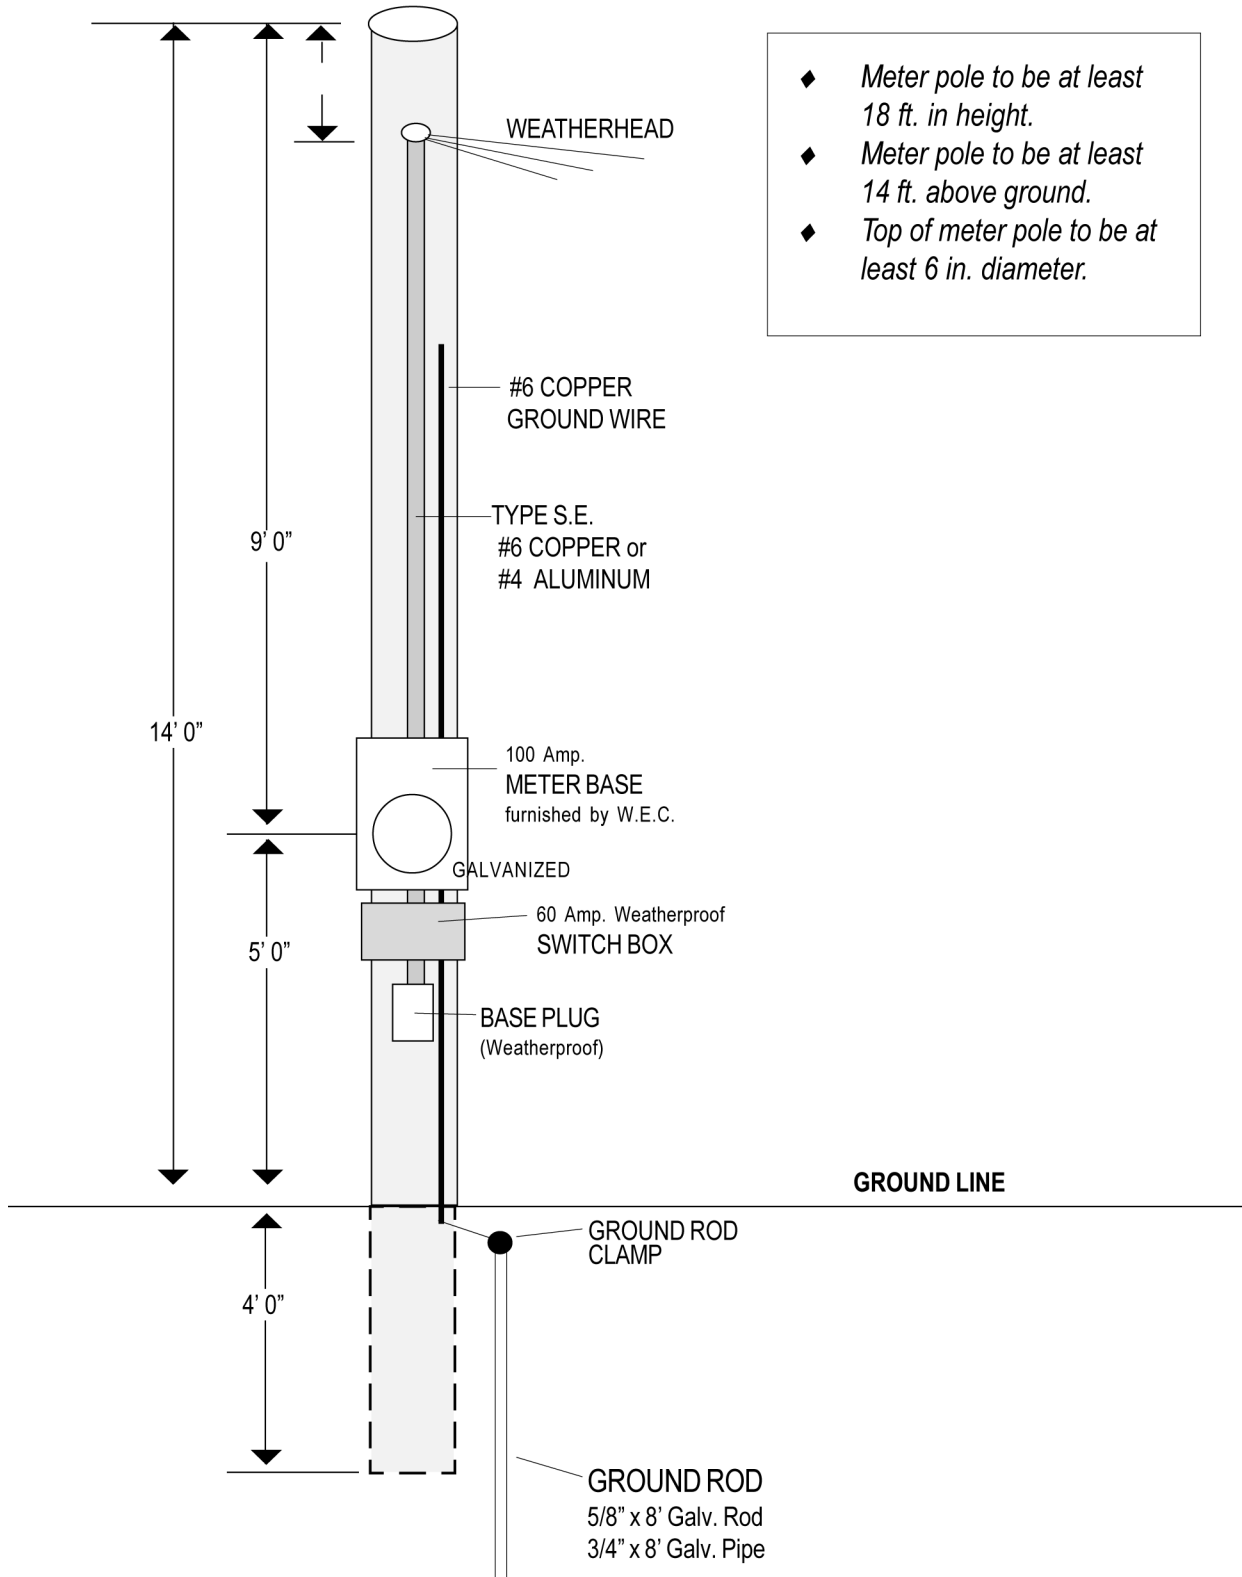

- ◆ Meter pole to be at least 18 ft. in height.
- ◆ Meter pole to be at least 14 ft. above ground.
- ◆ Top of meter pole to be at least 6 in. diameter.