




WIREFRASS

ELECTRIC COOPERATIVE

A PowerSouth Energy Cooperative

www.wiregrass.coop

Service Equipped for Underground Service

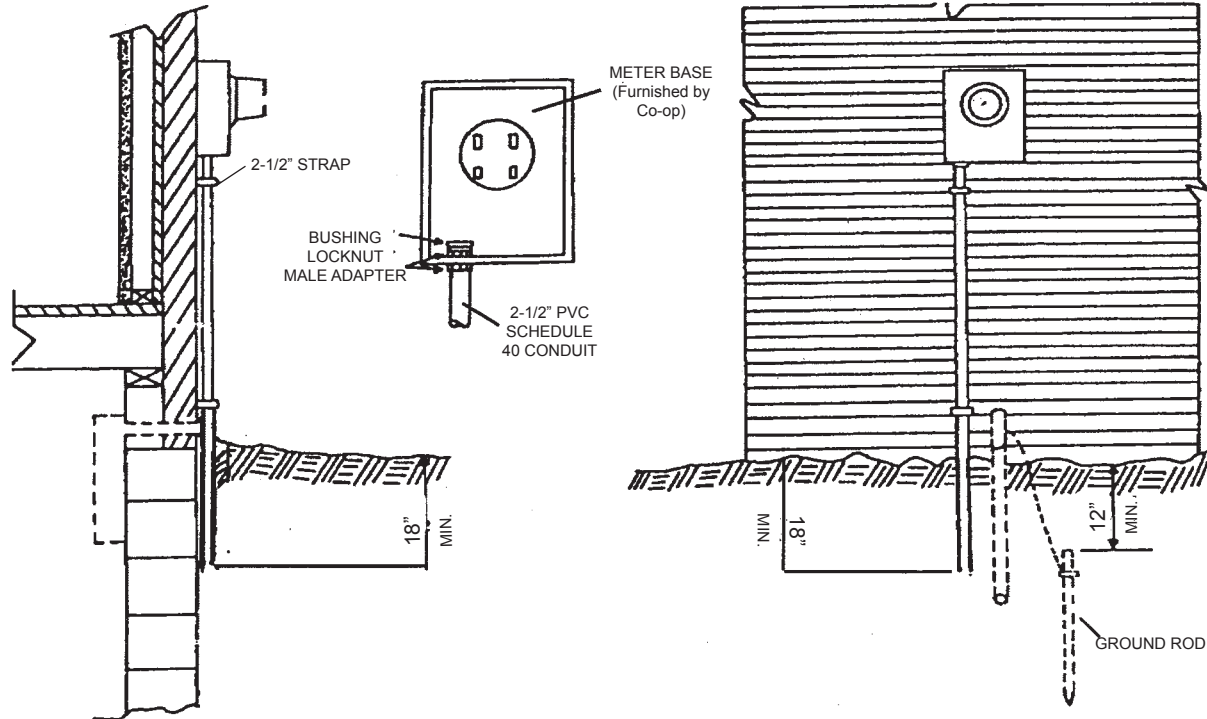

UNDERGROUND SERVICE

The builder or electrician will install 2-1/2" PVC Schedule 40 conduit for underground service to a minimum of 18 inches below ground level as well as at least 1 strap to hold conduit in place.

The diagram above describes specifications for underground service. Wiregrass Electric will furnish at no charge the underground meter base that will be installed on the side of the residence.

A ground rod is to be installed at a minimum depth of 12 inches below ground line.

While Cooperative personnel make every effort to cover trenches sufficiently, there can be a problem with indentations in the trench when soil settles, usually following rains. It is not the Cooperative's intention to destroy consumer's property; however, heavy equipment will leave signs. The Cooperative will not be responsible for landscaping problems, and consumer will take full responsibility for landscaping following installation of service.

